


## SKEMA PRIMARE E IMPIANTIT EKZISTUES 10KV

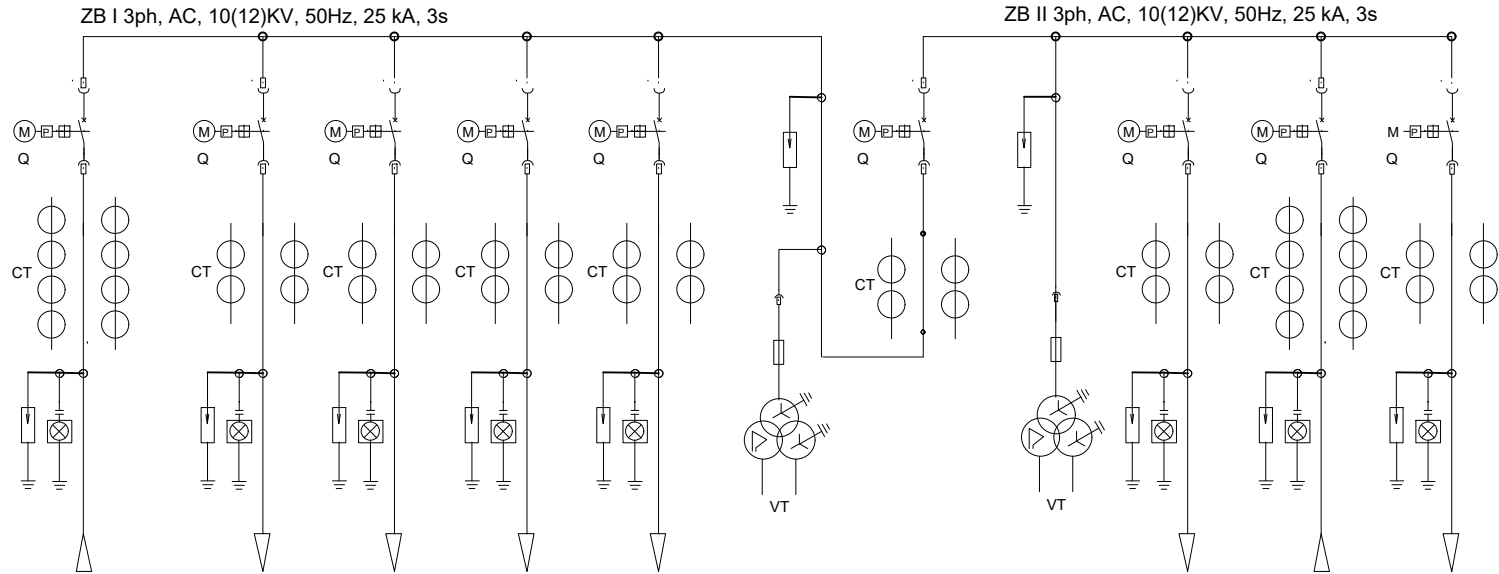

FIDRI / PAISJA	F1 N/st. 110kV	F 9T	F2 HVAC	F3 13&14T	F4 REZERVE	TT 1.	SEKSIONIMI	TT 2.	F5	ÇAT N/stac. 220	10T NV Hec.
FUQIA KW (KVA)											
ÇELSI	1250A;	1250A;	1250A;	1250A;	1250A;		1250A;		1250A;	1250A;	1250A;
TRANSFORMATOR MATES	TRR1 1000/5/5 A CL 0.5/1 TRR2 200/5/5 A CL 0.5/1	TRR 100/5/5 A CL 0.5/1	TRR 100/5/5 A CL 0.5/1	TRR 100/5/5 A CL 0.5/1	TRR 100/5/5 A CL 0.5/1	TT 10/1.732 KV 0.1/1.732; 0.1/3 CL 0.5;	TRR 100/5/5 A CL 0.5/1	TT 10/1.732 KV 0.1/1.732; 0.1/3 CL 0.5;	TRR 100/5/5 A CL 0.5/1	TRR1 1000/5/5 A CL 0.5/1 TRR2 200/5/5 A CL 0.5/1	TRR 100/5/5 A CL 0.5/1
SHKARKUES	3	3	3	3	3	3		3	3	3	3
LINJA / SEKSIONI / GJATESIA											

HEC FIERZE - SKEMA PRIMARE  
IMP SHPERNDARES EKZISTUES 10KV