

STACIONI POMPAVE SAMURR

00010203040506070809101112131415161718

A

A

B

B

C

C

D

D

E

E

F

F

G

G

H

H

I

I

J

J

K

K

L

L

M




M

N

N

00010203040506070809101112131415161718

PAMJE E STACIONI POMPAVE SAMURR

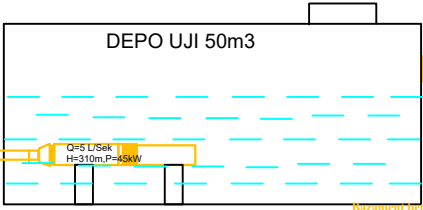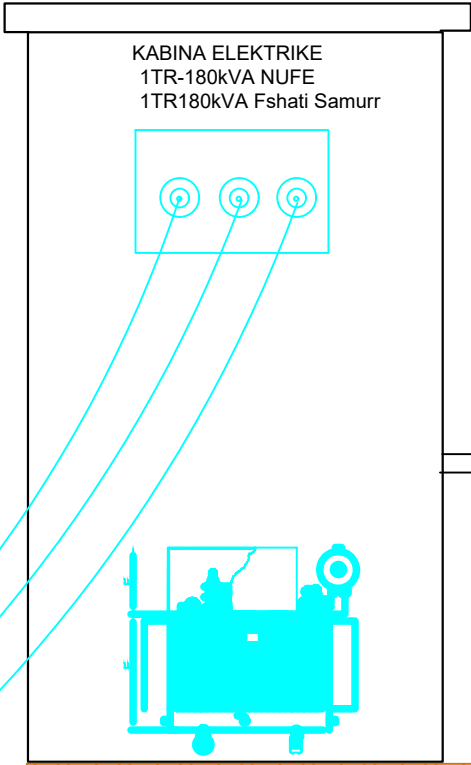

Q=5 l/ssek
H=310m, P=65kV


Bazamenti betoni 25x25
30x30

Tubi linjes Celik DN...../PN40



Arbhye nga STPM


Bazamenti betoni
25x25

Linje ekzistuese ajrore
6/10kV Fshati Samurr

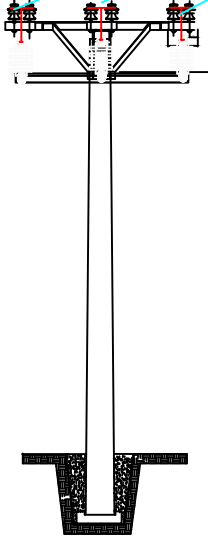


GJENDJA EKZISTUESE E INSTALIMEVE
ELEKTRO-MEKANIKE NE STPS

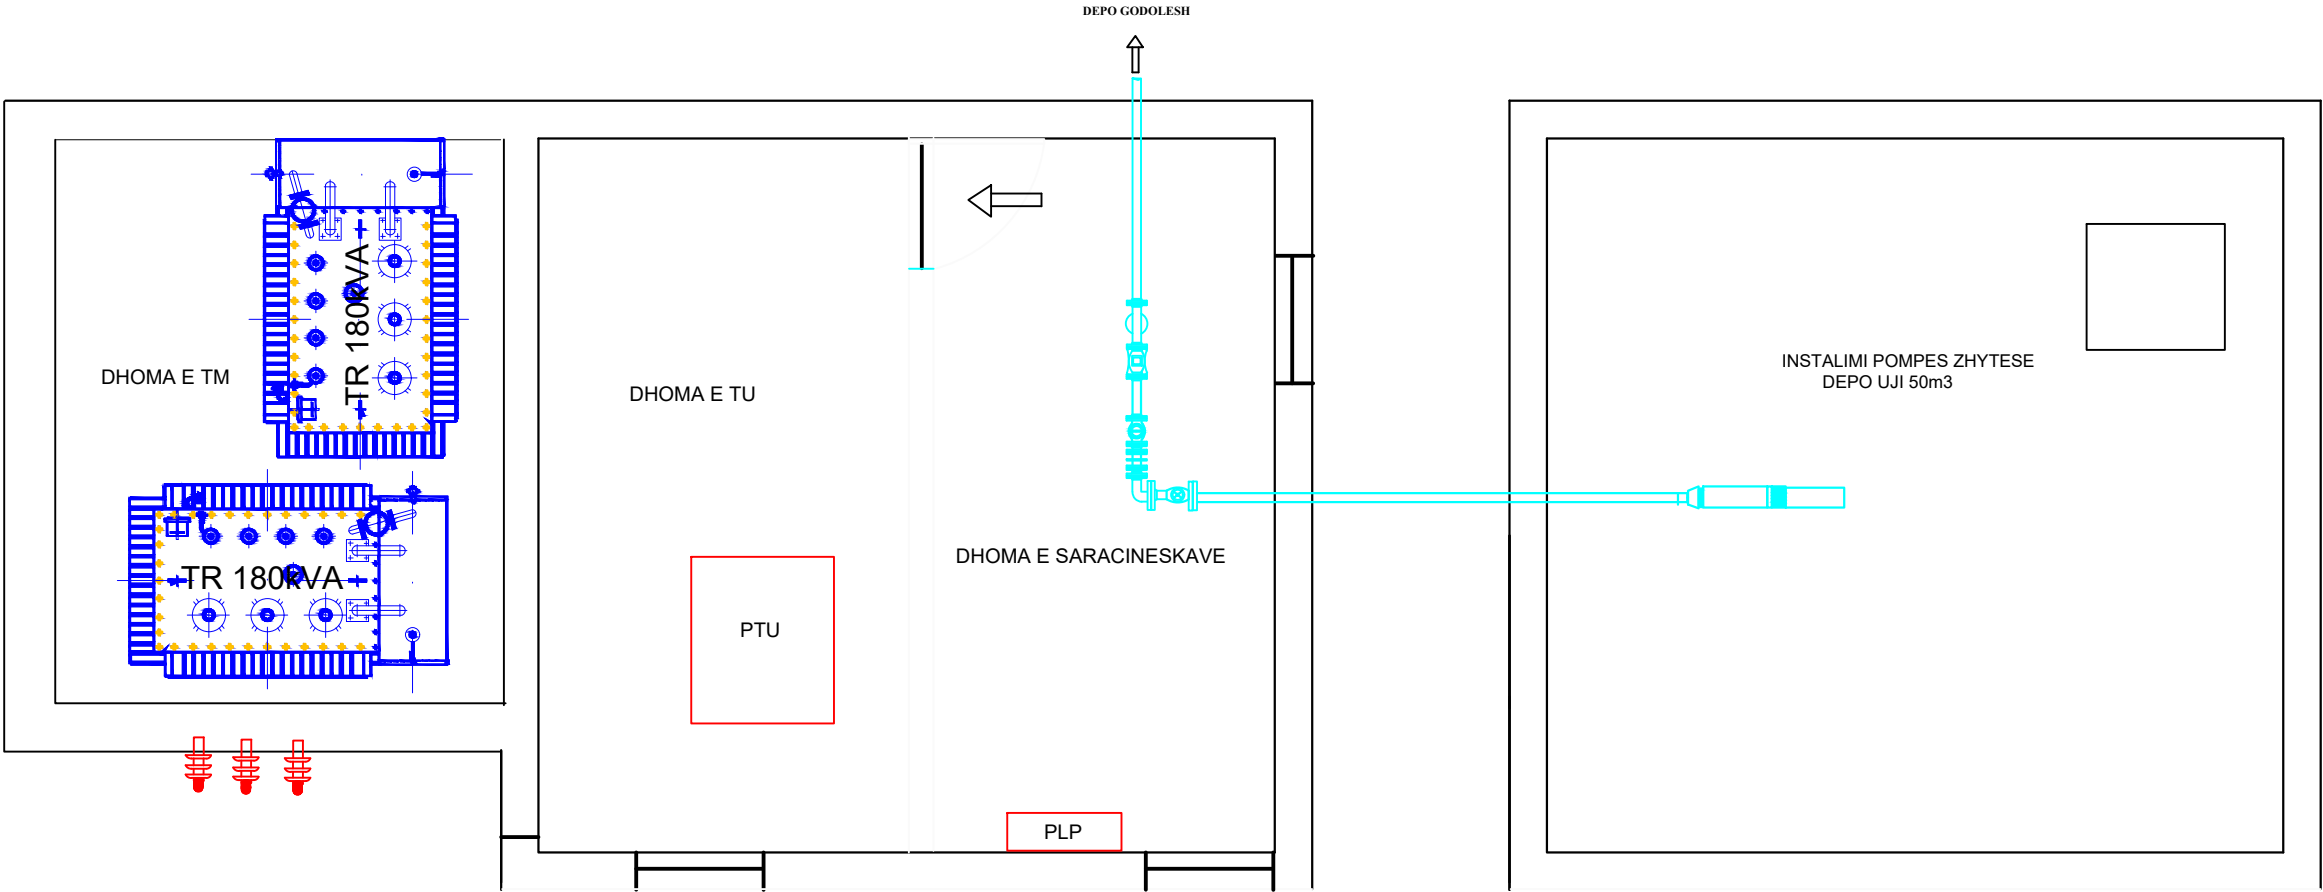

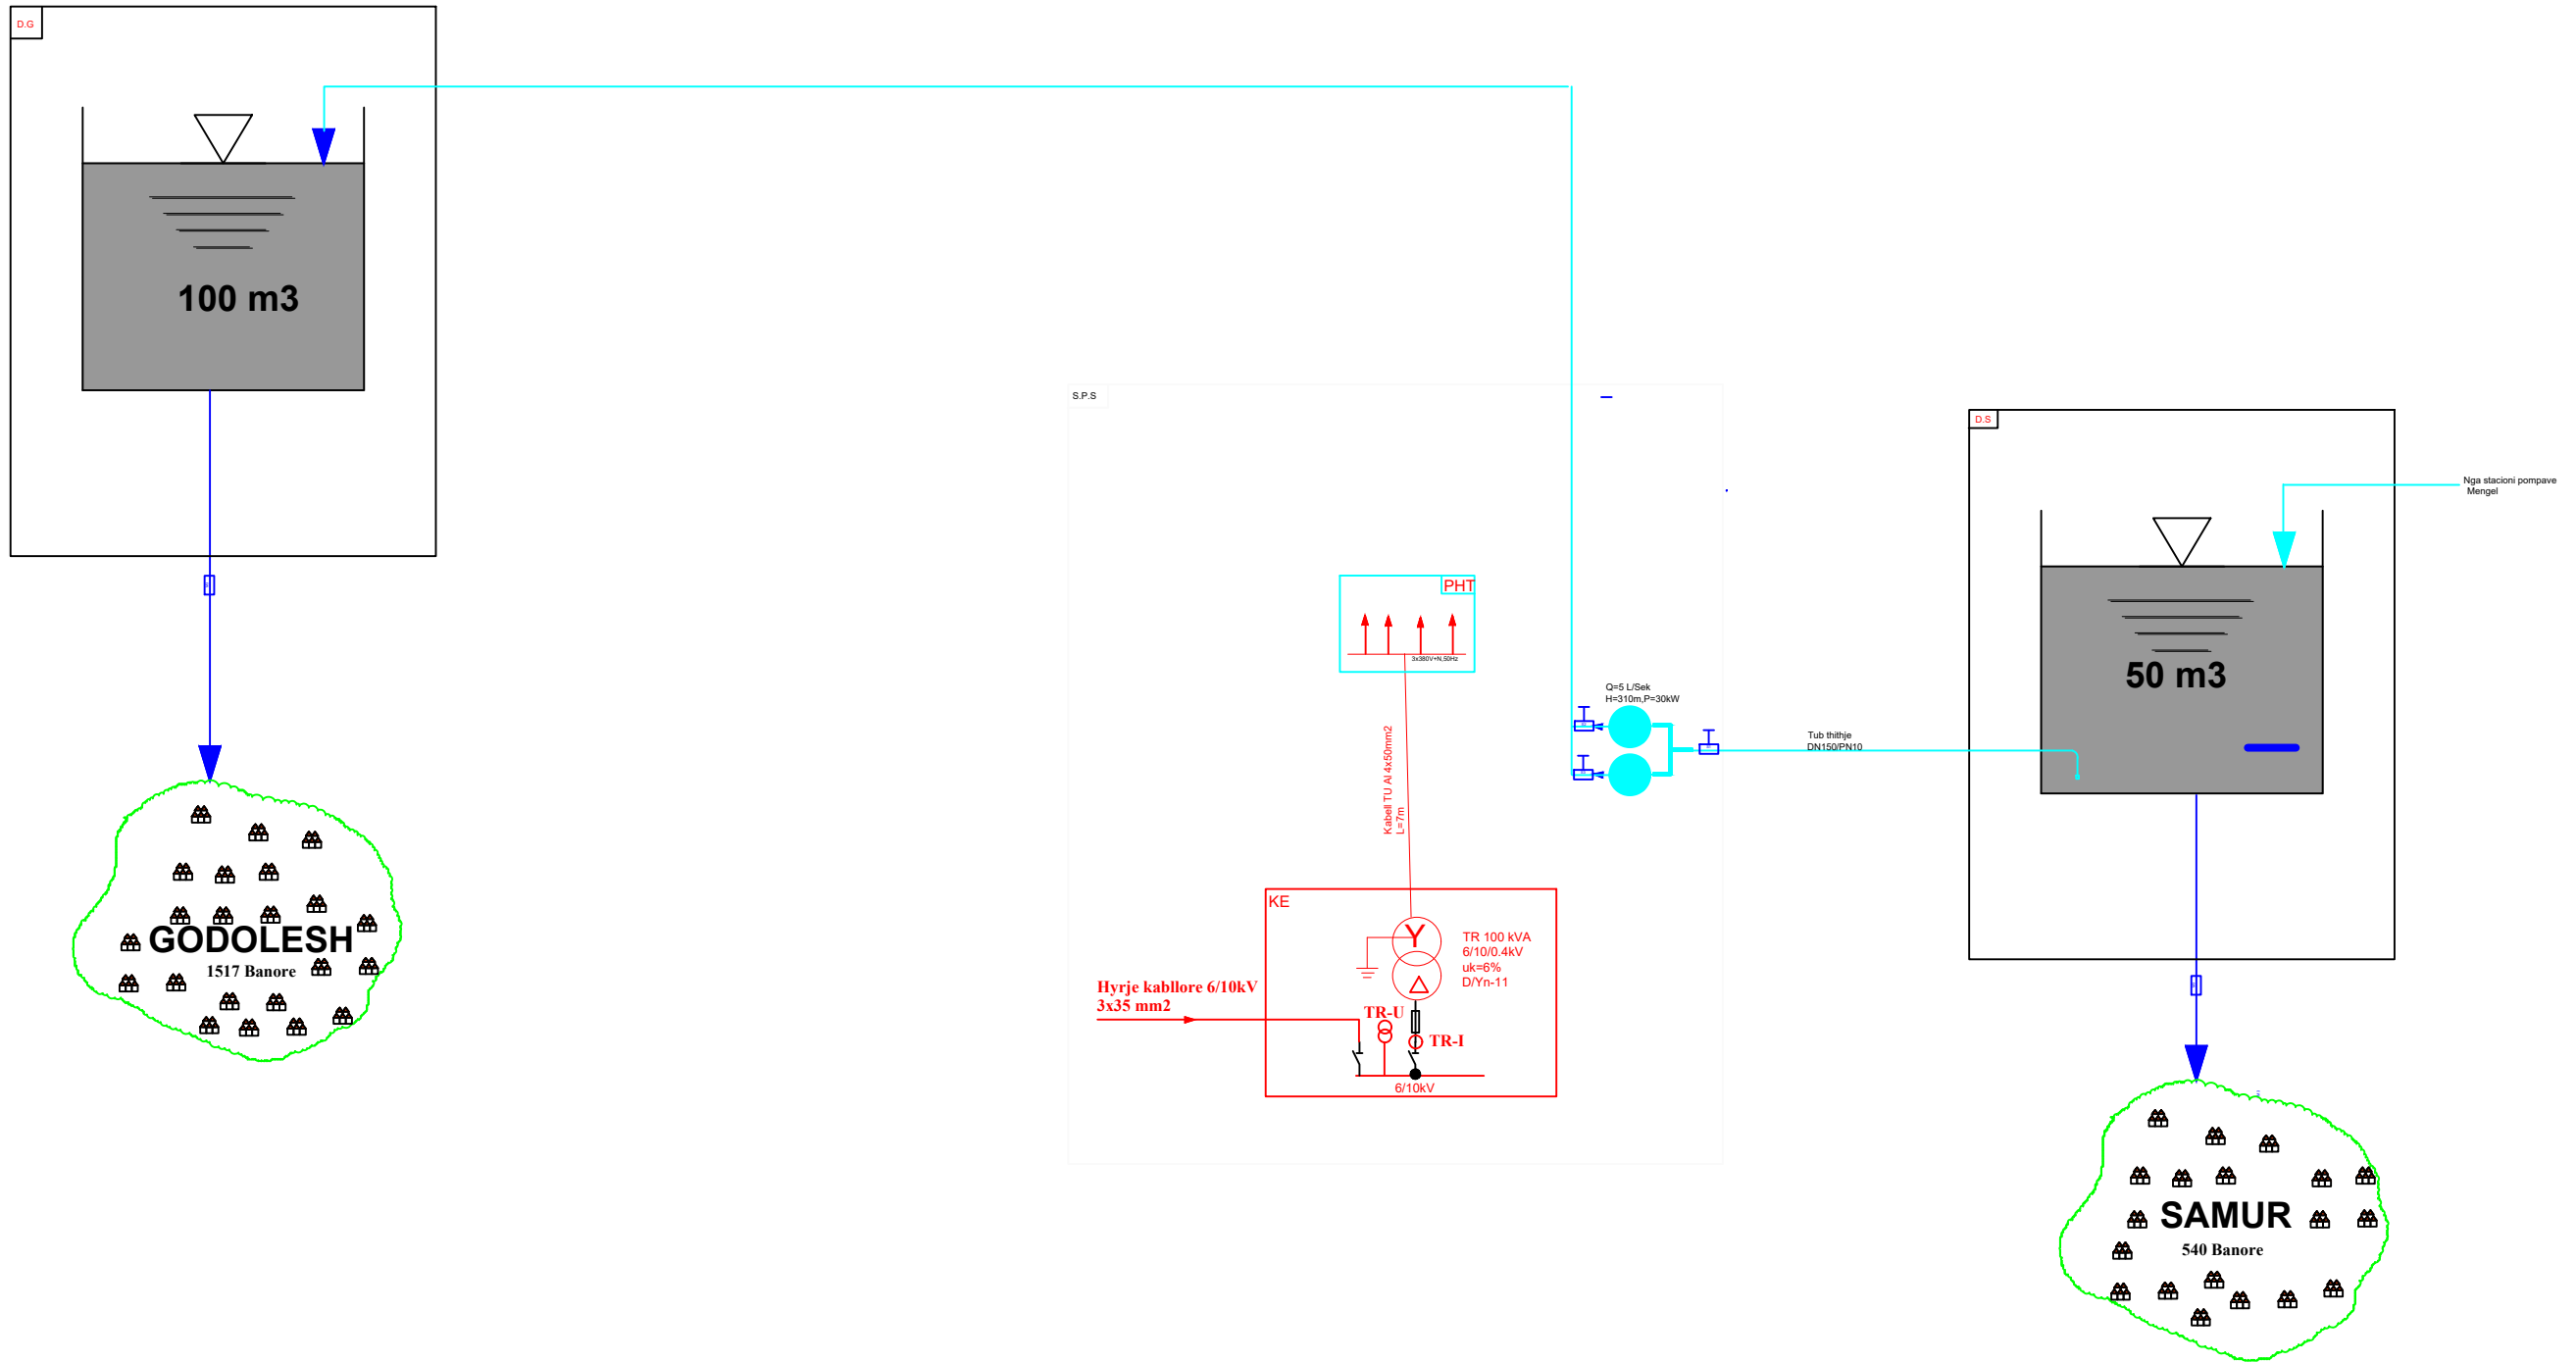


SKEMA E FURNIZIMIT ME ENERGJI E STACIONIT POMPAVE SAMURR



PIKA E LIDHJES NE TM 6/10kV

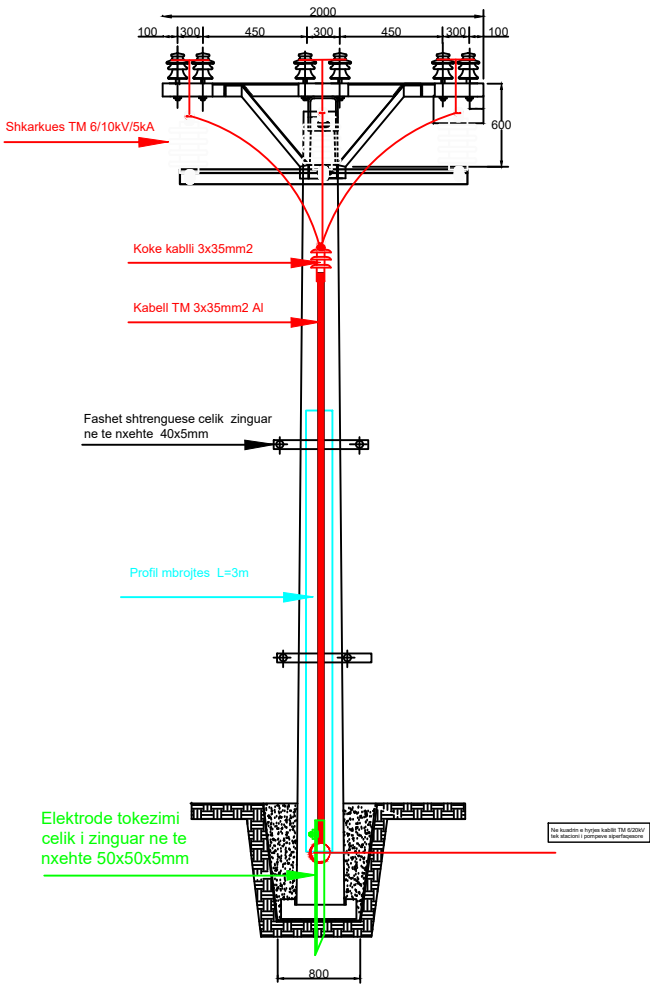

KUADROT TM1 DHE TM2

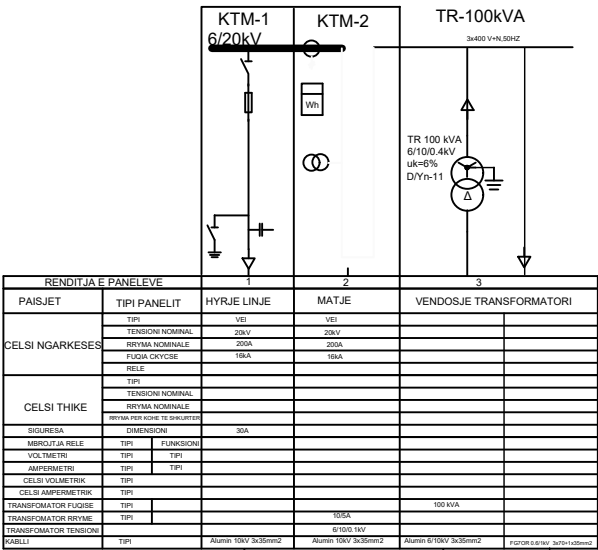


PANEL HYRJJE TR-100kVA

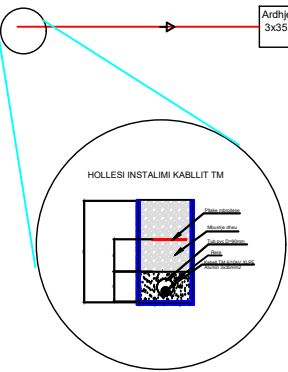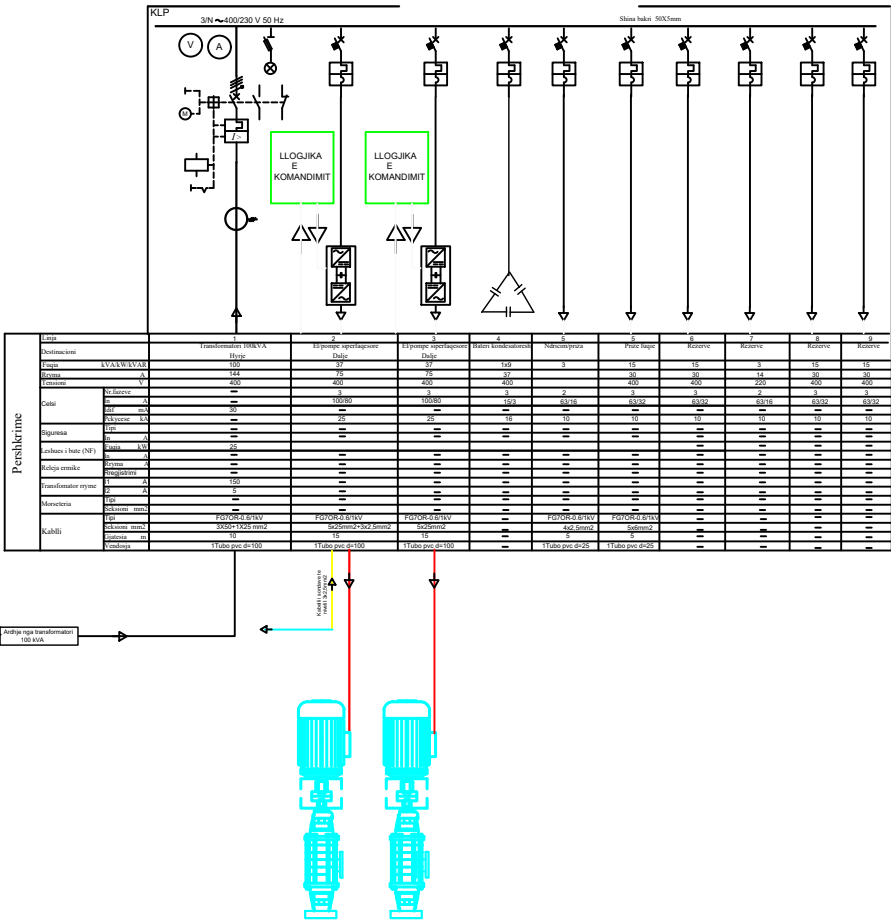


PAMJA E JASHTEME E KTM DHE PHTR-100 KVA NE STPS



KUADROT E TM KM1 DHE KM2

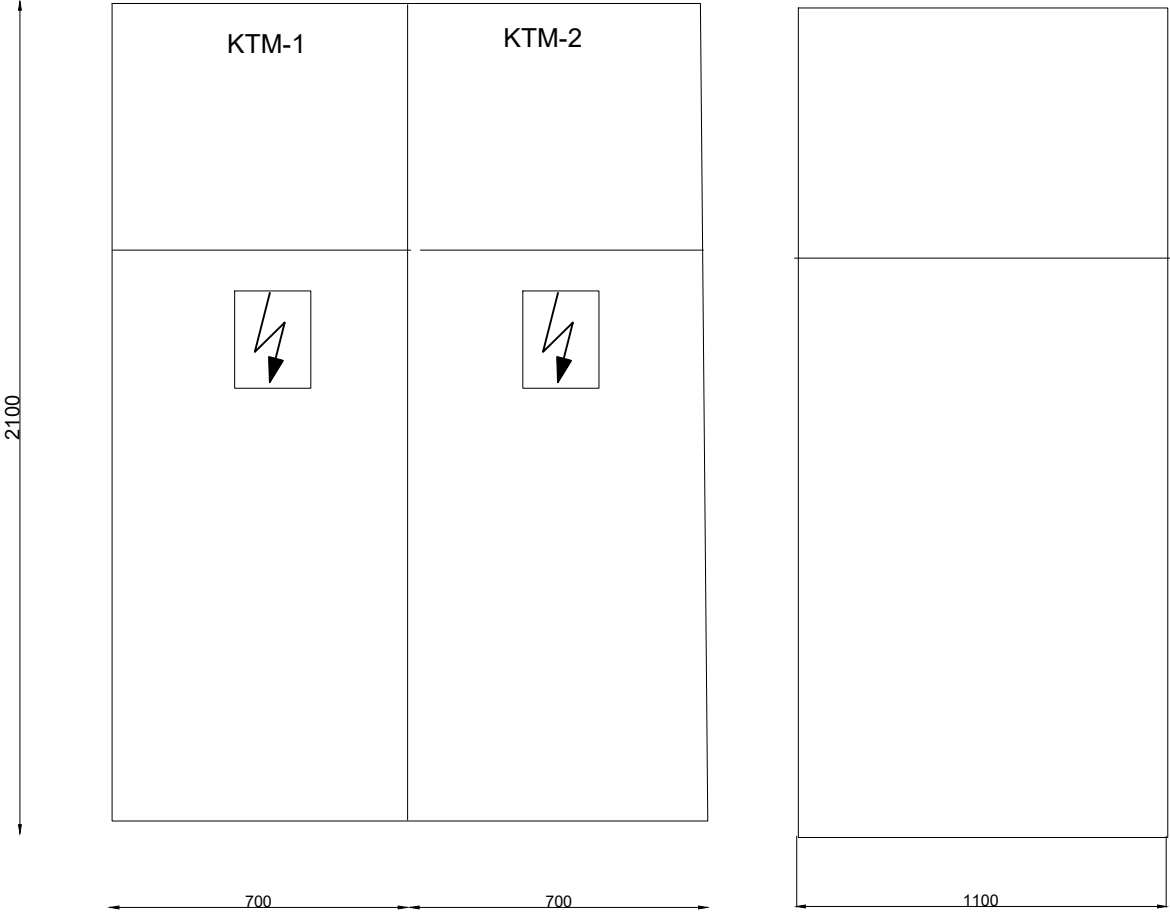





PANEL HYRJE TR-100kVA

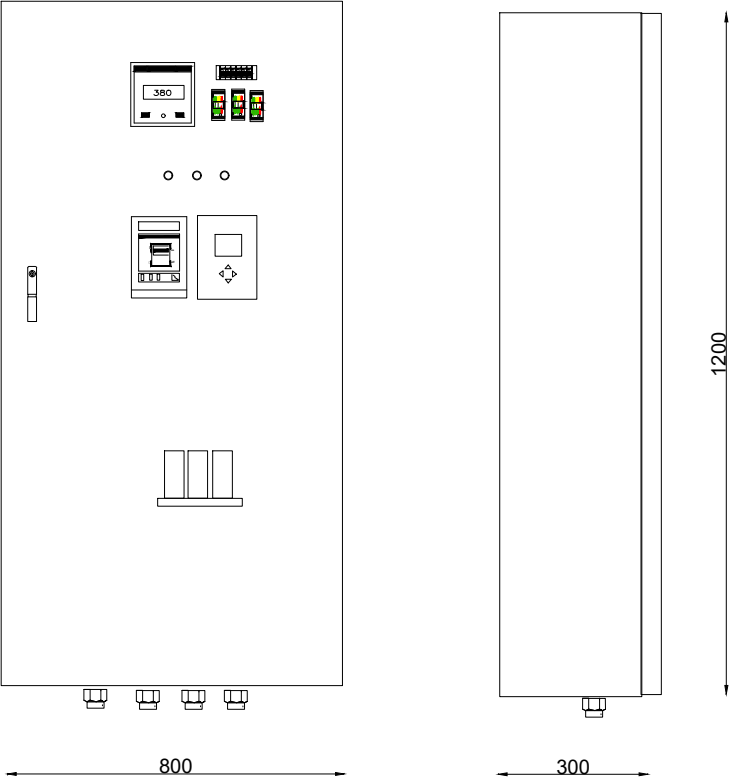



INSTALIMI PAISJEVE ELEKTROMEKANIKE NE STPS

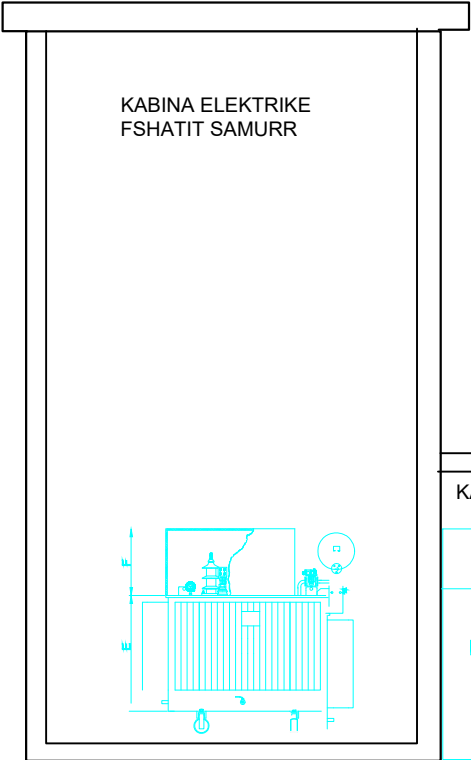


STACIONI POMPAVE

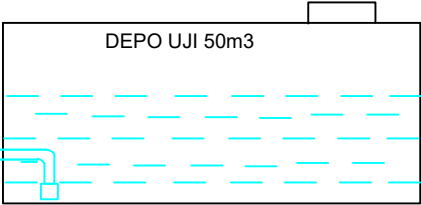


INSTALIMET E FUQISE,NDRICIMIT,PRIZAT STPS

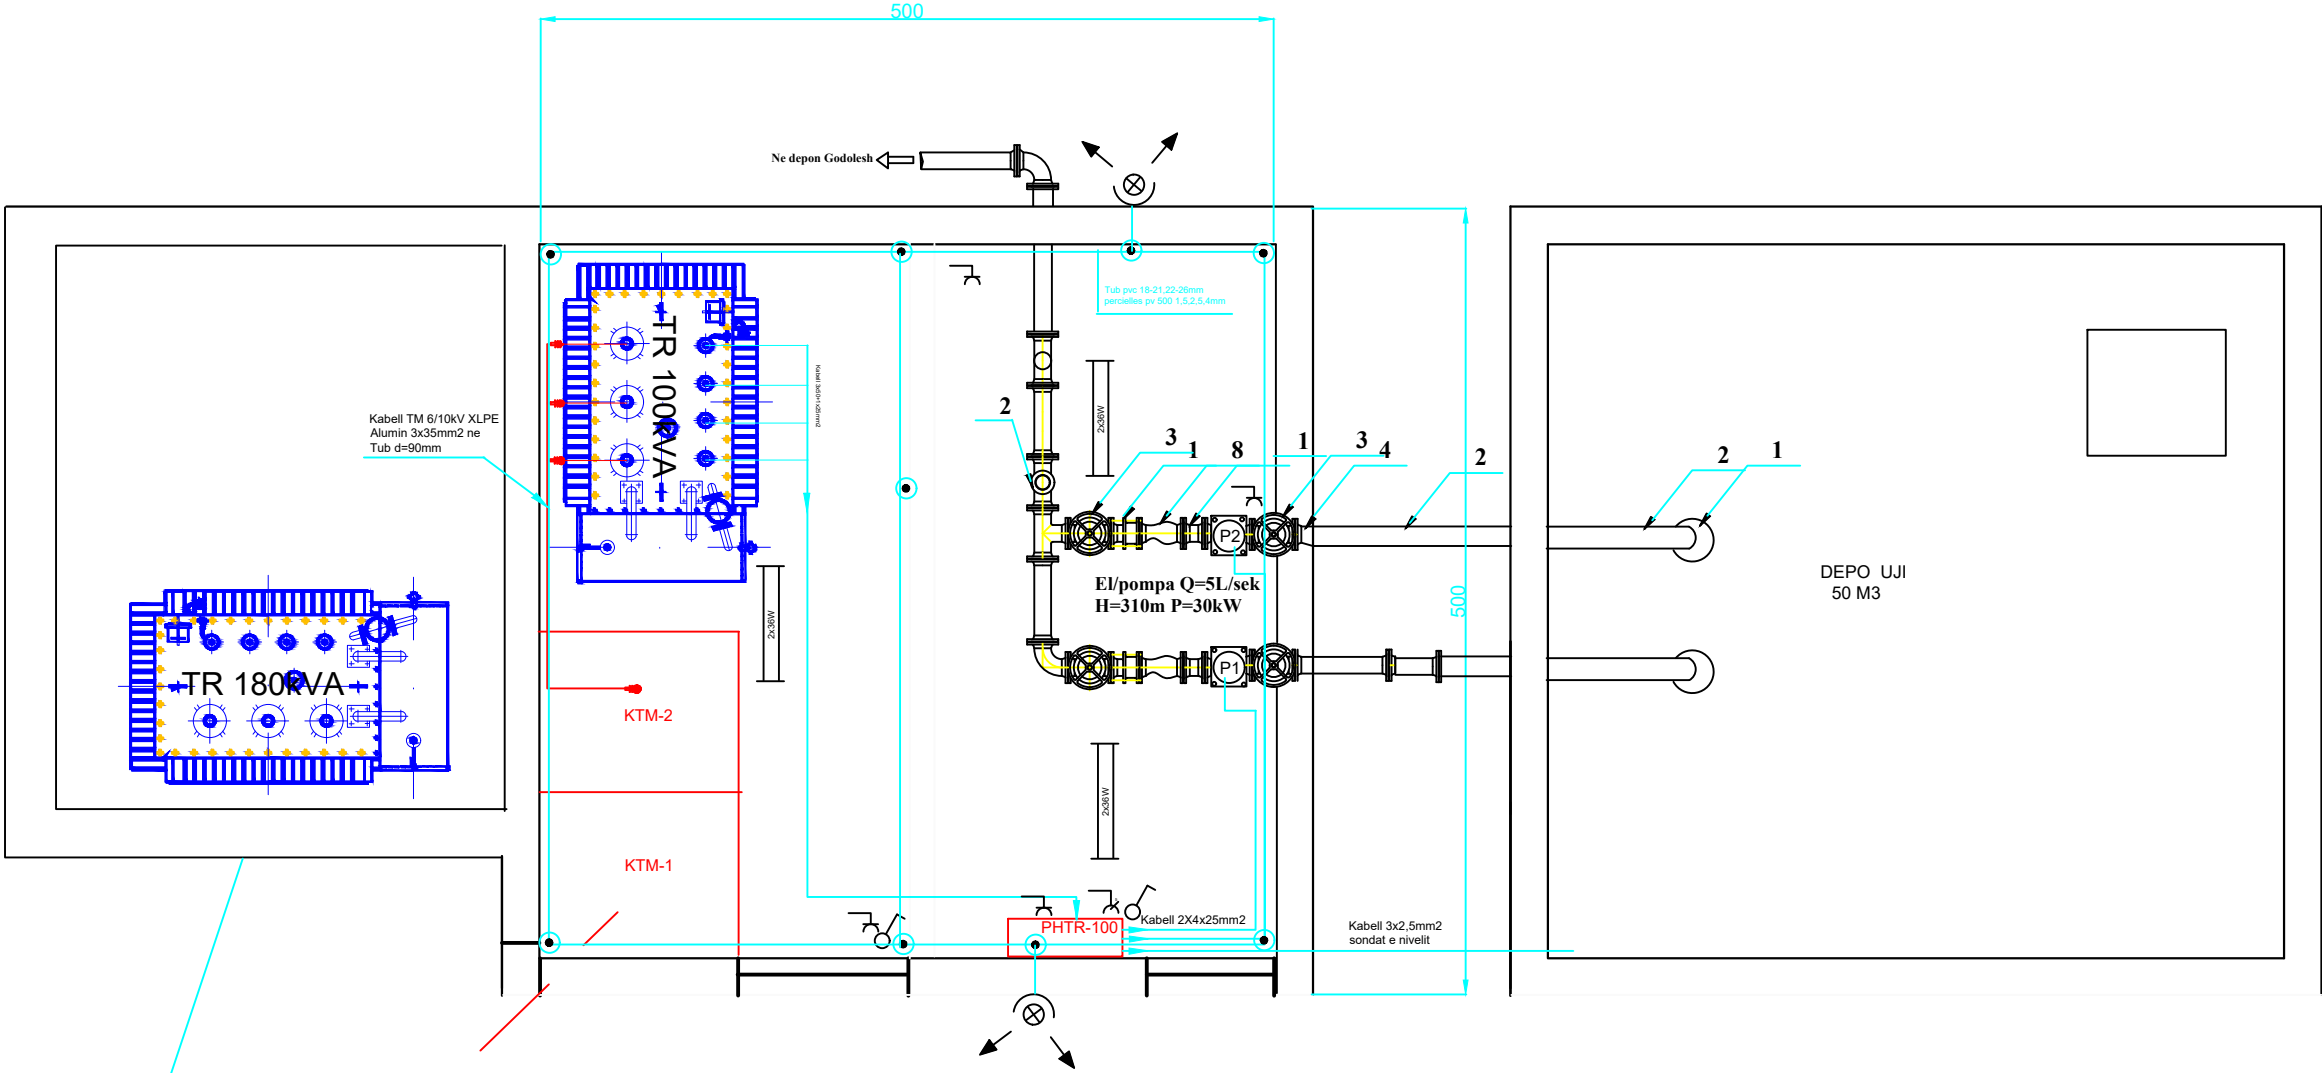

Pila e lidhjes TM 6/10kV



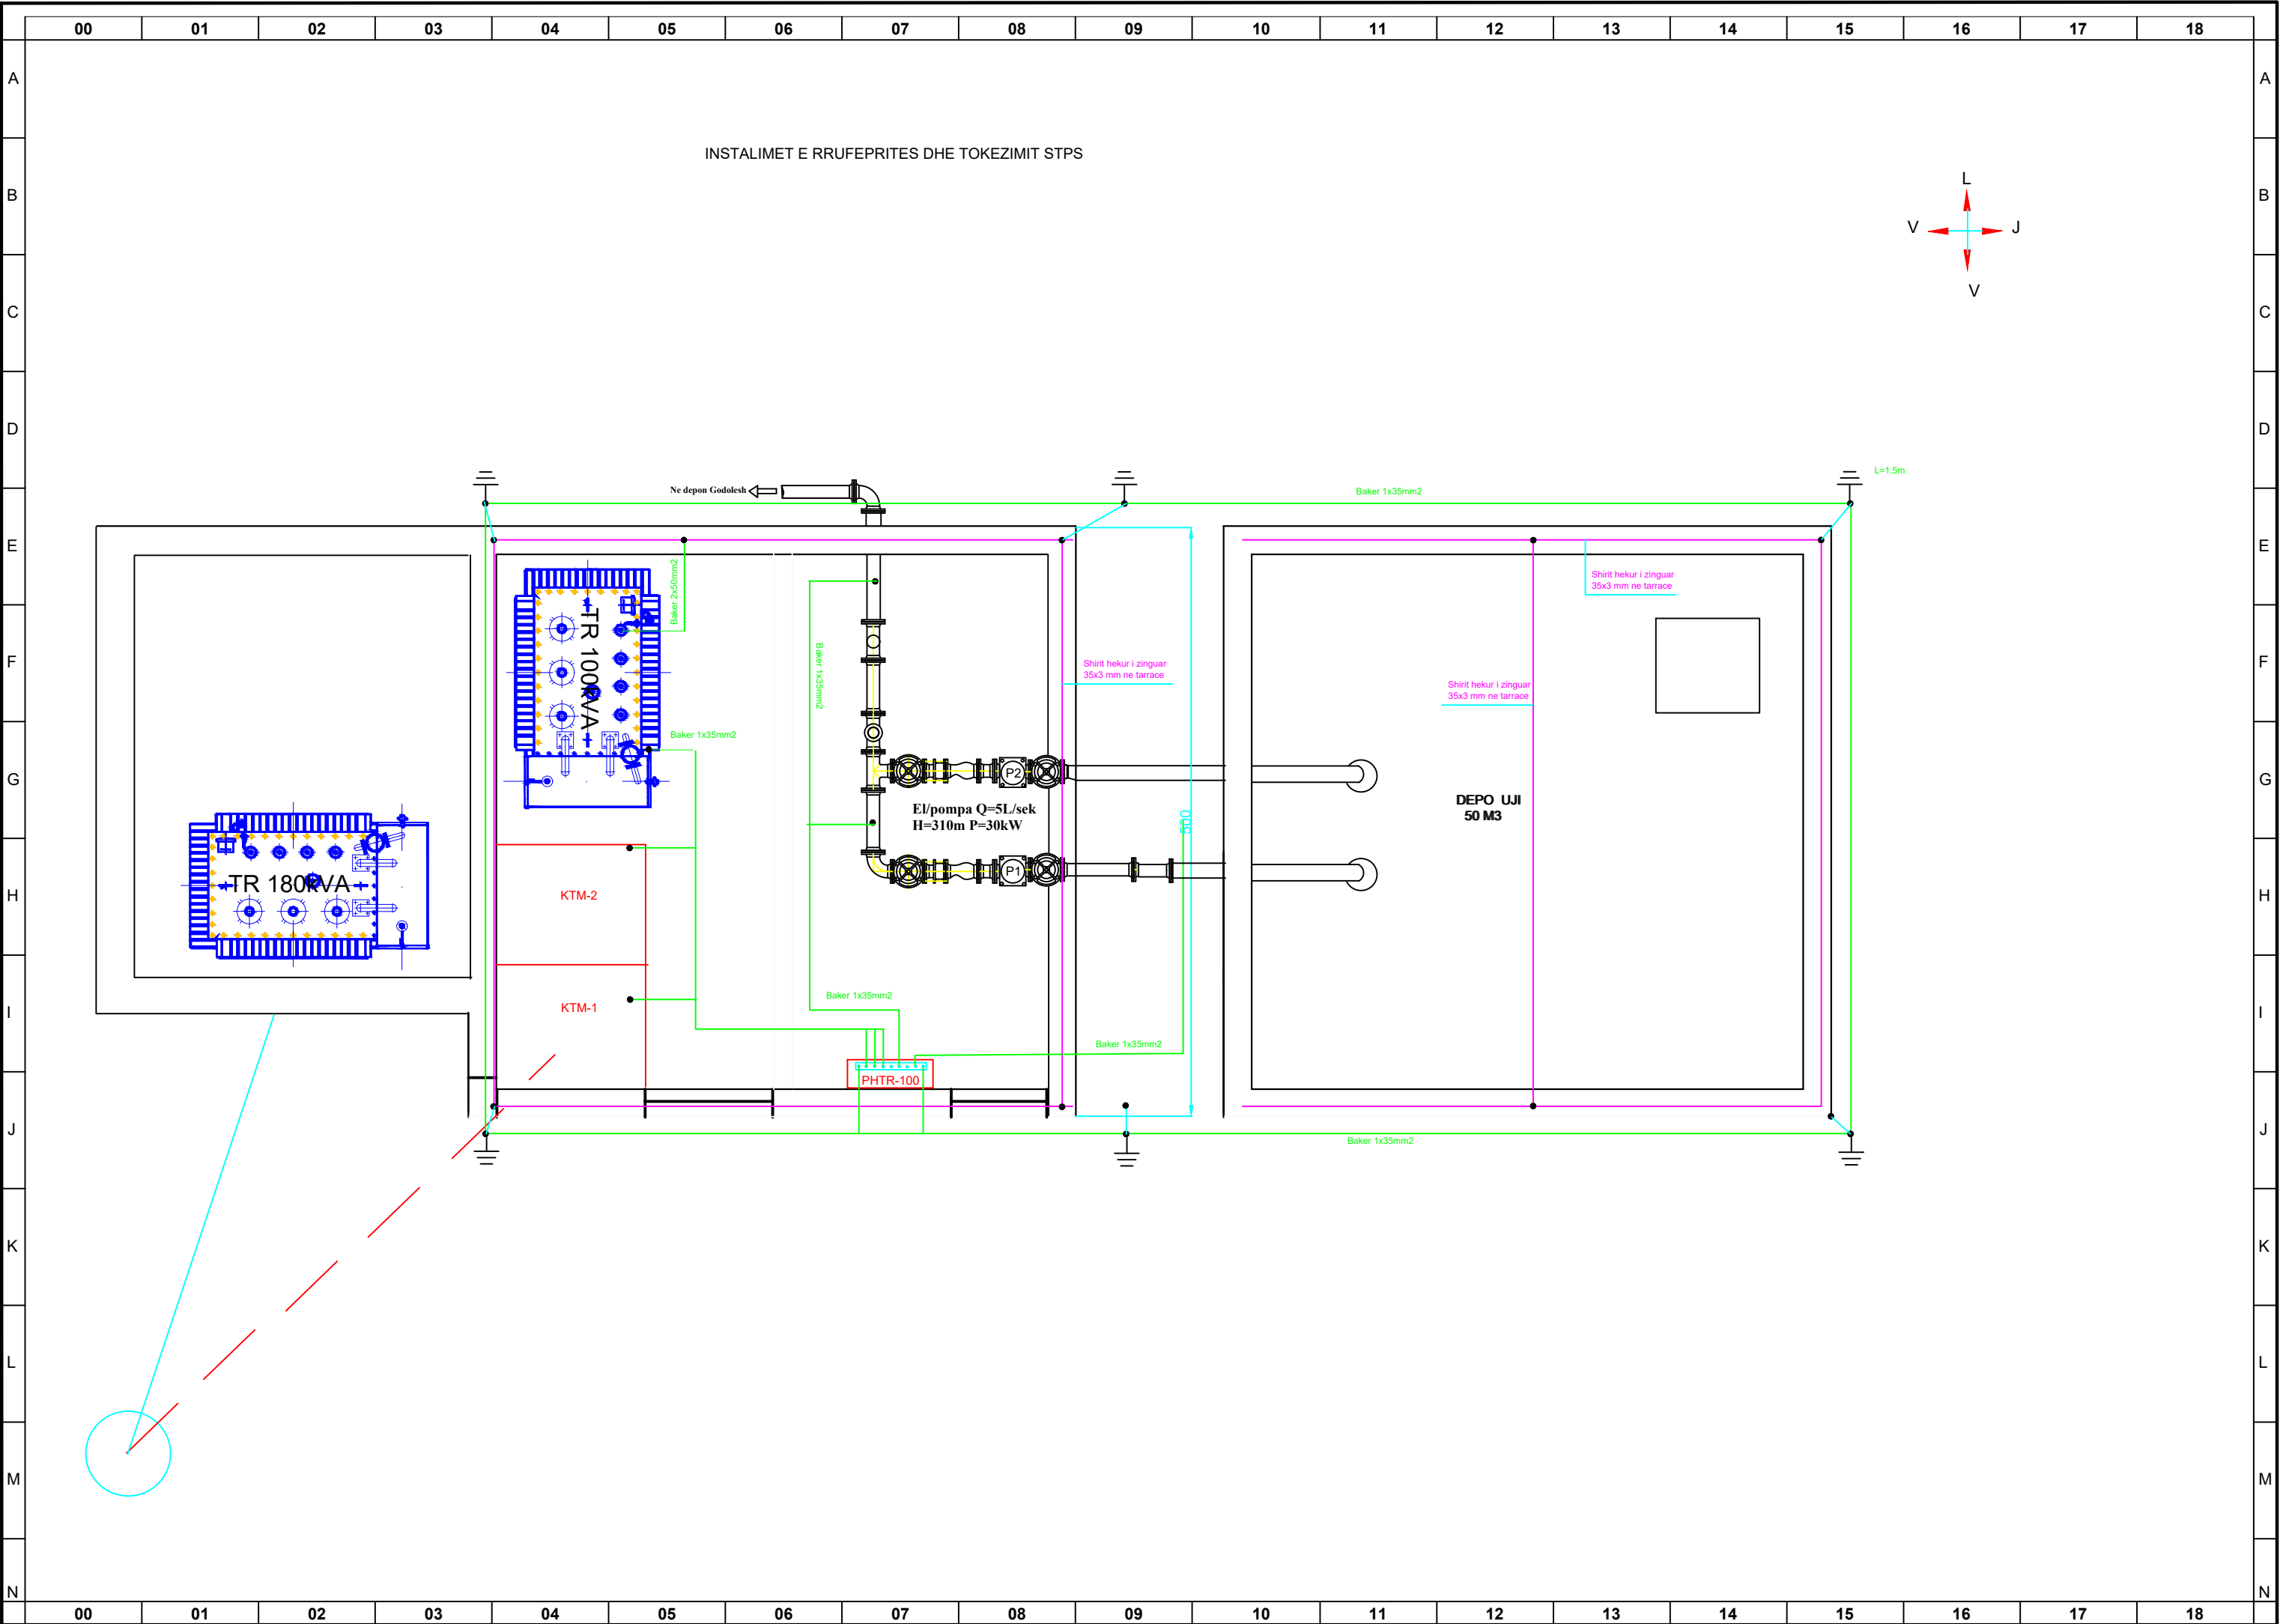

SKEMA E MATJEVE TE PRURJEVE,NIVELEVE DHE ENERGJISE ELEKTRIKE

